
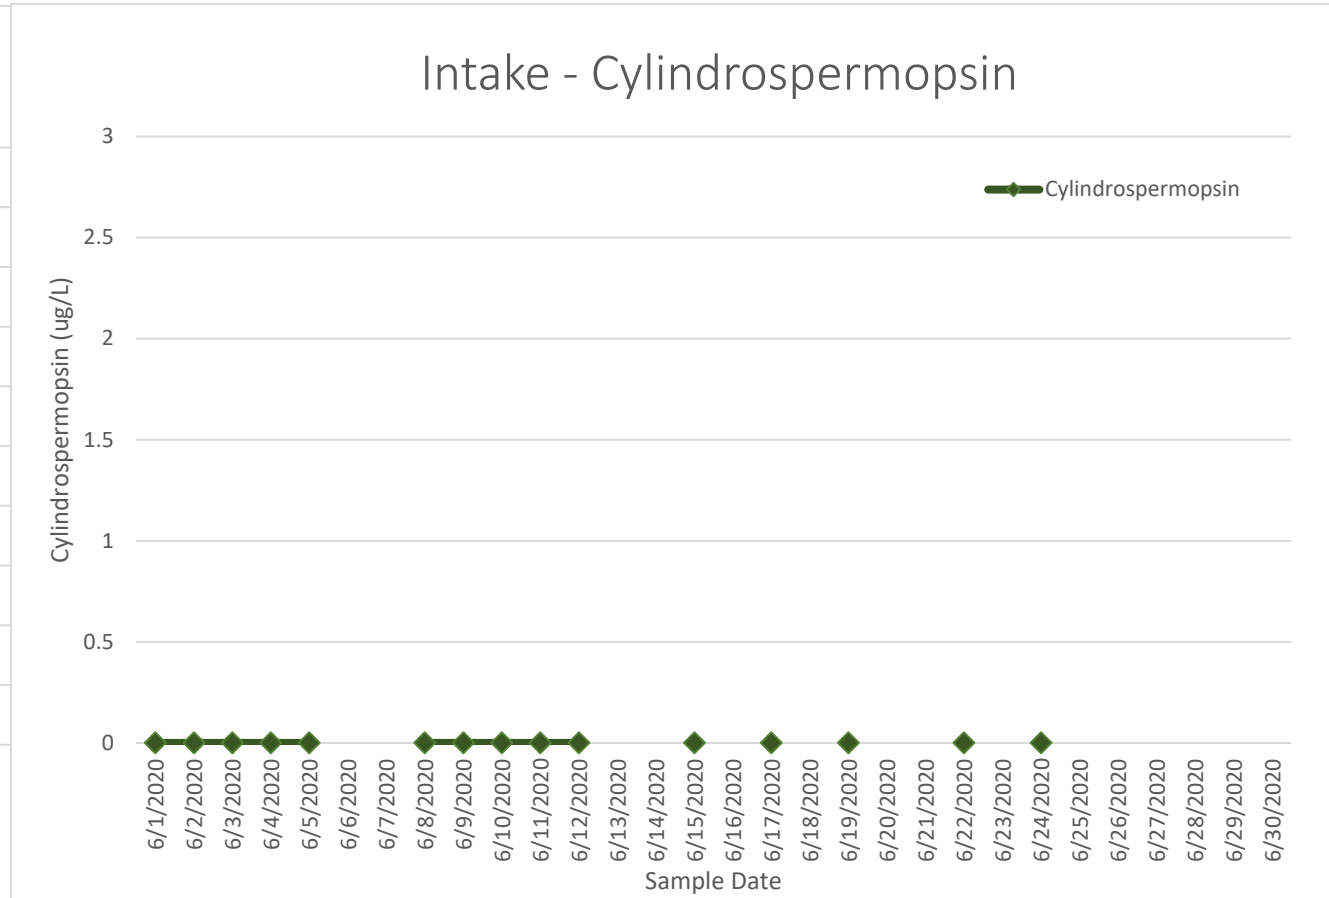


Intake Data - Raw River Water Entering the Geren Island Water Treatment Facility

| Sample Date | Microcystin | | Cylindrospermopsin | | Laboratory |
|--------------------|--|--|--|--|-------------------|
| | <i>Lab Reported Concentration</i>¹ | <i>Minimum Reporting Level</i>² (µg/L) | <i>Lab Reported Concentration</i>¹ | <i>Minimum Reporting Level</i>² (µg/L) | |
| 6/1/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/2/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/3/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/4/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/5/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/6/2020 | | 0.3 | | 0.1 | |
| 6/7/2020 | | 0.3 | | 0.1 | |
| 6/8/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/9/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/10/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/11/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/12/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/13/2020 | | 0.3 | | 0.1 | |
| 6/14/2020 | | 0.3 | | 0.1 | |
| 6/15/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/16/2020 | | 0.3 | | 0.1 | |
| 6/17/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/18/2020 | | 0.3 | | 0.1 | |
| 6/19/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/20/2020 | | 0.3 | | 0.1 | |
| 6/21/2020 | | 0.3 | | 0.1 | |
| 6/22/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/23/2020 | | 0.3 | | 0.1 | |
| 6/24/2020 | Below Detection Limit | 0.3 | Below Detection Limit | 0.1 | Willow Lake |
| 6/25/2020 | | 0.3 | | 0.1 | |
| 6/26/2020 | | 0.3 | | 0.1 | |
| 6/27/2020 | | 0.3 | | 0.1 | |
| 6/28/2020 | | 0.3 | | 0.1 | |
| 6/29/2020 | | 0.3 | | 0.1 | |
| 6/30/2020 | | 0.3 | | 0.1 | |

¹The Lab Reported Concentration is a non-detect when the data concentration is less than the minimum reporting level. The unit µg/L is the same as micrograms per liter of water.

²The Minimum Reporting Level (RL)—is the lowest concentration at which an analyte - Total Microcystin or Cylindrospermopsin - can be detected in a sample and its concentration can be reported with a reasonable degree of accuracy and precision.

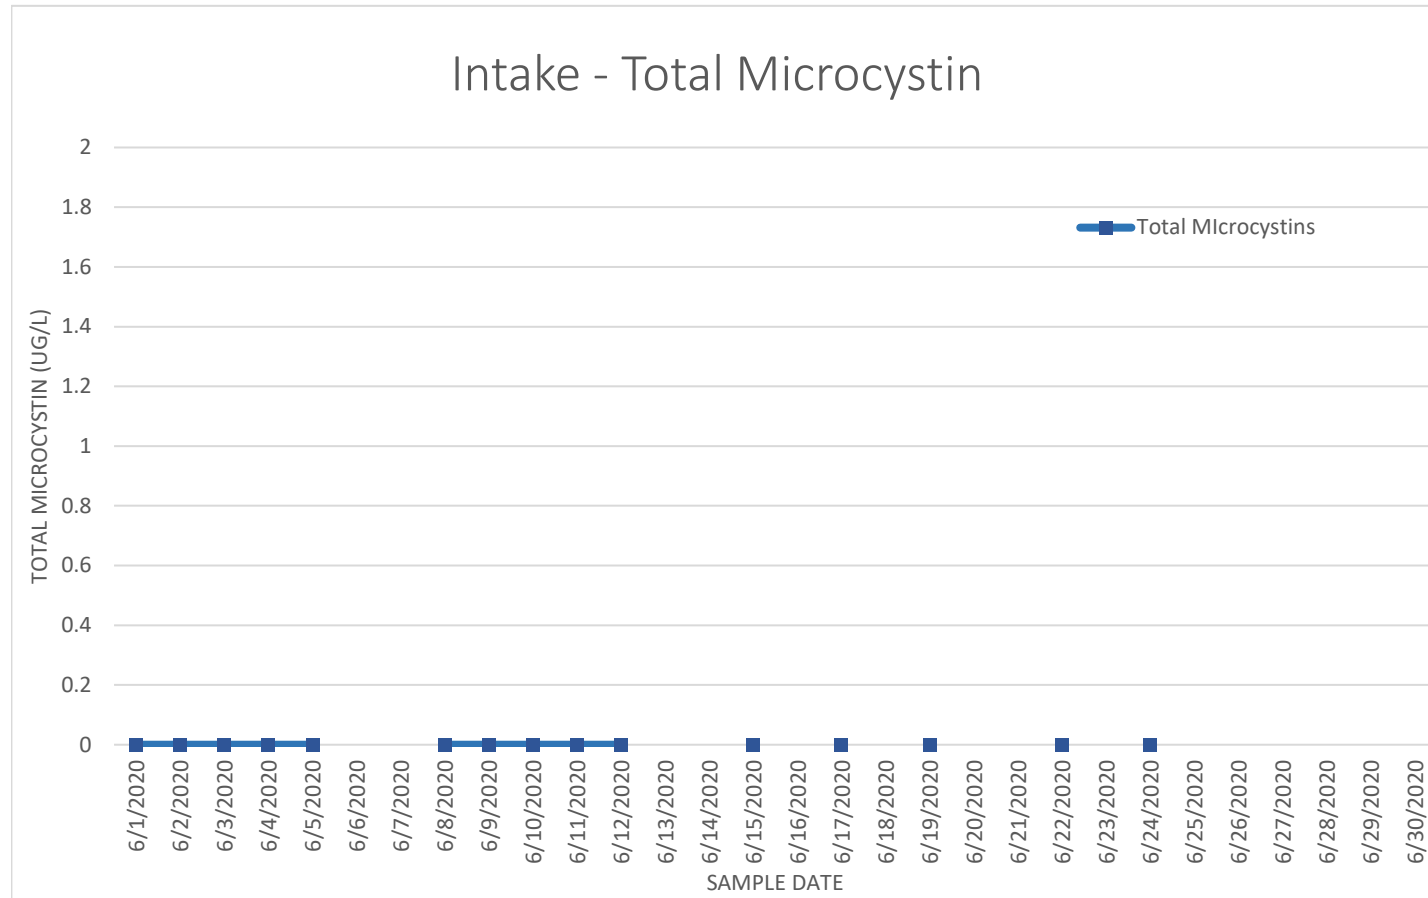

For more about cyanotoxins and drinking water advisories in Salem, visit: <https://cityofsalem.net/water-advisory>