


FOR REVIEW

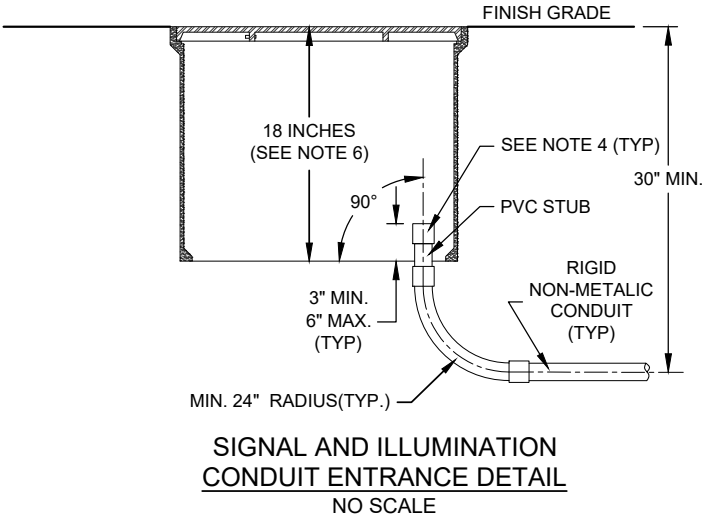

- NOTES:
- 1. CONDUITS SHOWN ARE FOR EXAMPLE ONLY. ADDITIONAL CONDUITS MAY BE REQUIRED AS SHOWN ON THE PLANS.
 - 2. ALL SIGNAL AND ILLUMINATION CONDUIT ELBOWS SHALL BE FACTORY MADE OF FIBERGLASS, HAVE A MINIMUM RADIUS OF 24" AND INCLUDE FACTORY BELL ENDS.
 - 3. CONDUIT ENTRANCE FOR NEW CONSTRUCTION SHALL BE THROUGH THE OPEN BOTTOM OF UNDERGROUND ENCLOSURES AND NEAR THE END WALLS TO LEAVE THE MAJOR PORTION OF THE BOX CLEAR.
 - 4. INSTALL FIBERGLASS END BELLS ON ALL CONDUIT TERMINATIONS.
 - 5. UNDERGROUND ENCLOSURES USED TO SERVICE FRANCHISE UTILITIES MAY HAVE DIFFERENT OR ADDITIONAL REQUIREMENTS.
 - 6. 12" DEEP ENCLOSURE MAY BE ALLOWED IN RETROFIT SITUATIONS.

				CITY OF SALEM			
				DEPARTMENT OF PUBLIC WORKS			
CHANGES	ALL NEW DRAWING			STANDARD PLAN			
				SIGNAL AND ILLUMINATION			
				CONDUIT ENTRANCE DETAIL			
APPROVED				DRAWN BY	KLA	5/2024	NO.705C
	CITY ENGINEER		DATE	CHECKED BY	WAK	5/2024	